



Email

HVAC@ramfab.com



Old Unit: _____

New Unit: _____
(Unit Model Numbers)

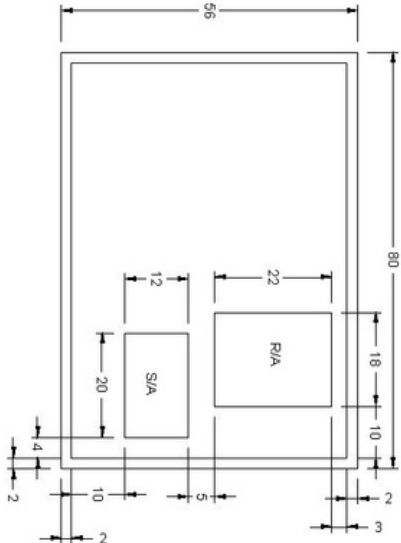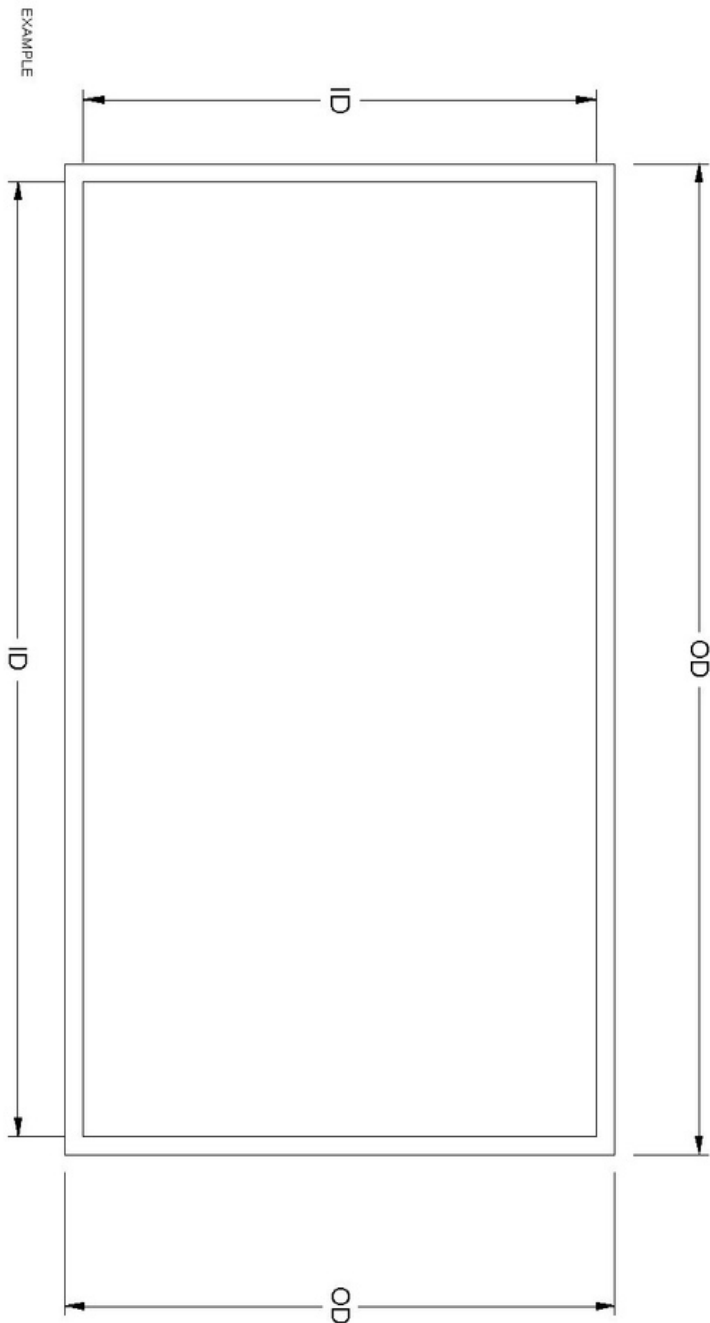

1. MEASURE THE OUTER DIMENSIONS OF THE EXISTING CURB.
2. MEASURE THE ID OF THE EXISTING CURB IF POSSIBLE
3. INDICATE THE LOCATION AND SIZE OF THE EXISTING RETURN AND SUPPLY DUCT.
4. LABEL THE SUPPLY AND RETURN OPENINGS.
5. NOTE ANY OBSTRUCTIONS AROUND THE CURB THAT MAY INTERFERE WITH THE NEW UNIT.